


ELEVATION

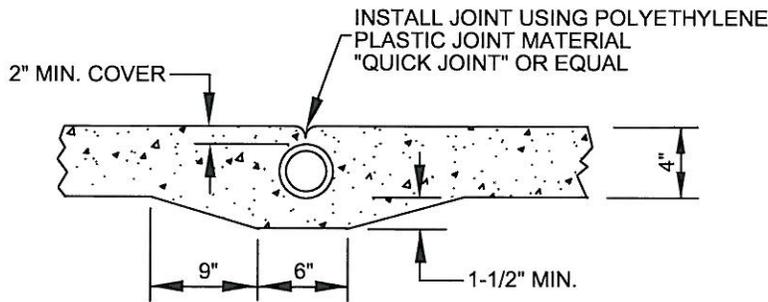

SIDEWALK SECTION "A-A"

NOTES:

1. DRAINS SHALL BE 3 INCH DIA. P.V.C. PIPE (SCHEDULE 40) OR RECTANGULAR CAST IRON BOX FOR 6 INCH CURB FACE AND 4 INCH DIA. P.V.C. PIPE (SCHEDULE 40) OR RECTANGULAR CAST IRON BOX FOR 8 INCH CURB FACE.
2. THE CURB SHALL BE CORED FOR ALL DRAIN PIPES.
3. THE NUMBER OF PIPES AT ANY LOCATION SHALL NOT EXCEED 4 @ 12" O.C.



APPROVED BY:
Kip D. Field 11/23/09
 CITY ENGINEER DATE
 KIP D. FIELD

CITY OF CORONA

**CURB DRAIN
 RESIDENTIAL**

REVISION	DESCRIPTION	BY	DATE